Subject to Fire Marshal Approval

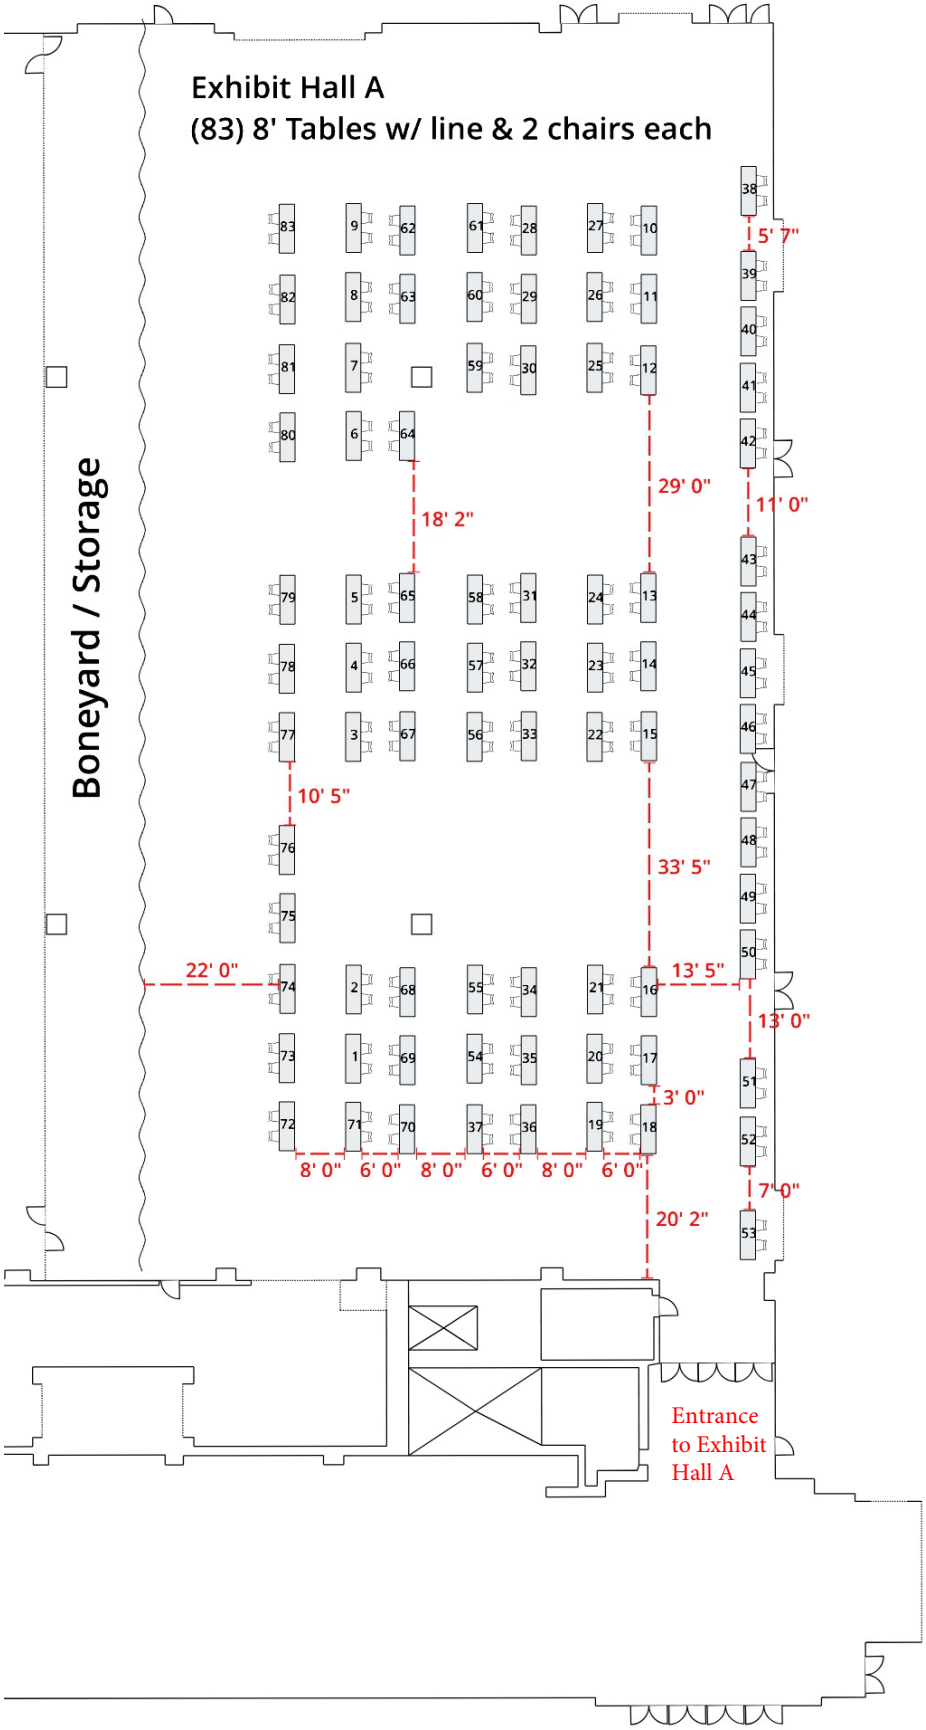

10 Feet